

TC	ANB	ANB	ANB
DWG	DES	CHK	APP
8/2020	new standard		
REV	ISSUE		

TRENCH RESTORATION/ PIPE BEDDING FOR UNPAVED AREAS

DATE: AUG 2020
DESIGN: ANB
DRAWN: TC

DRAWING NO.
C-5
1 of 1


12" OF TOPSOIL OR CSBC AS NOTED ON APPROVED PLAN OR AS DIRECTED BY CDID1

1' MIN.
FROM DISTURBED
TRENCH WALL
SEE NOTE 4

2-FOOT
MIN COVER

TRENCH BACKFILL SHALL MEET THE STANDARD SPECIFICATION FOR CRUSHED SURFACING BASE COURSE (CSBC) AND BE PLACED PER WSDOT SPEC 2-09.3(1)E

TRENCH RESTORATION
PIPE BEDDING

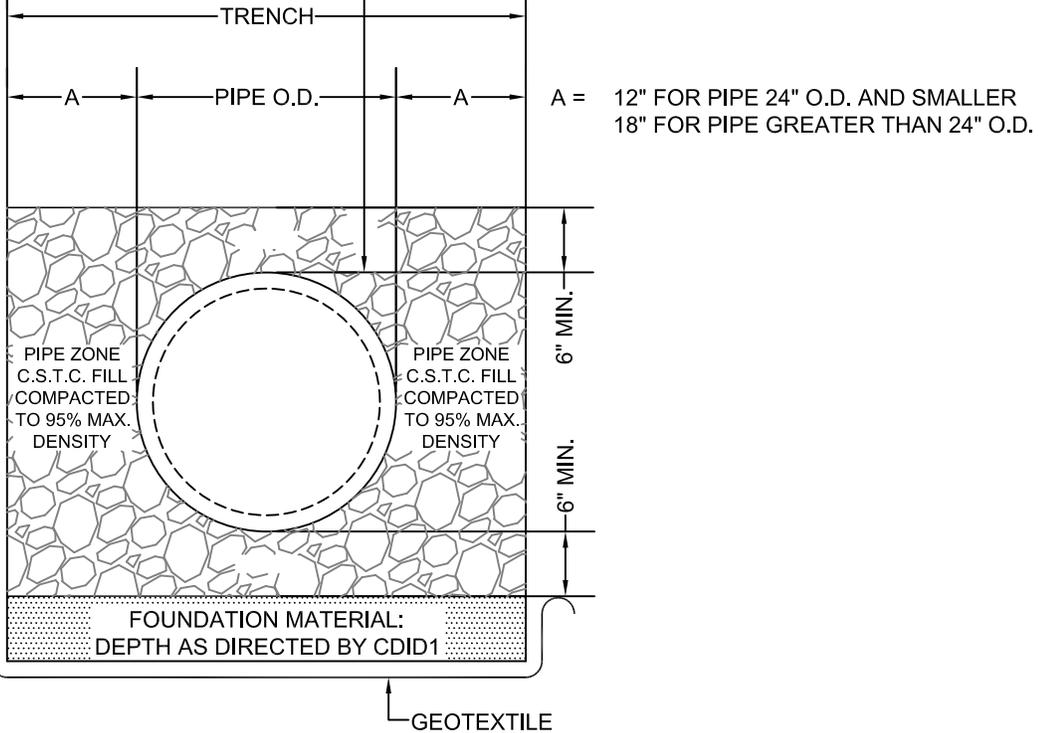

NOTES:

- 1) TRENCH BACKFILL SHALL BE COMPACTED IN 6-INCH MAXIMUM LIFTS TO 95% DENSITY AS DETERMINED BY ASTM D1557.
- 2) GEOTEXTILE SHALL MEET THE REQUIREMENTS OF WSDOT SPEC 9-33.2(1) TABLE 3.
- 3) CRUSHED SURFACING SHALL MEET THE REQUIREMENTS OF WSDOT SPEC 9-03.9(3).
- 4) FOR TRENCH RESTORATION IN PAVED AREAS, EXISTING PAVEMENT SHALL BE VERTICALLY SAWCUT IN STRAIGHT LINES. WIDTH OF PAVEMENT PATCH SHALL EXTEND AT LEAST 12-INCHES BEYOND DISTURBED TRENCH WALL ON BOTH SIDES OF TRENCH.
THICKNESS OF PAVEMENT PATCH SHALL BE THE GREATER OF: 3" FOR COMPACTED HMA; and 8" FOR CEMENT CONCRETE; or THICKNESS OF EXISTING PAVEMENT PLUS 2".